


Tri-Clamp tee spool piece	
Adapter Order Code	FTP-15T-20T
Inlet/Outlet Connection	Tri-Clamp 2"
Sensor Connection	Tri-Clamp 1.5"
Norm	DIN 32676

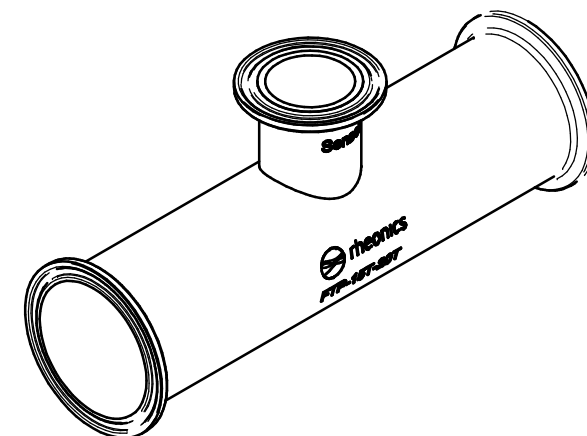

Units: mm
[inch]

FTP-15T-20T Tri-Clamp tee spool piece


This drawing remains property of rheonics. It may be neither copied nor informed to third persons or competitors without our approval. (2 paragraph 1 fig.7 copyright act of 9th Sept. 1965)

Protected by US and International patents granted and pending

rheonics • Switzerland • USA • www.rheonics.com • info@rheonics.com +41 52 511 32 00 +1 713 364 5427


Release: 2502

rheonics 
inline process
density and viscosity
monitoring

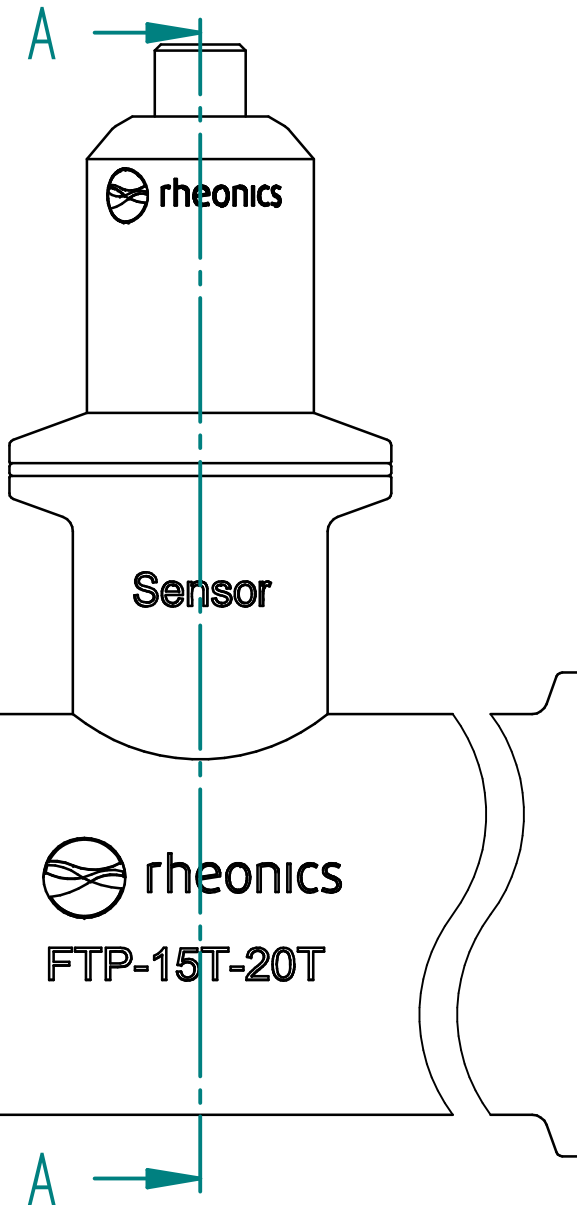


Units: $\frac{\text{mm}}{[\text{inch}]}$

SRV-X3-15T

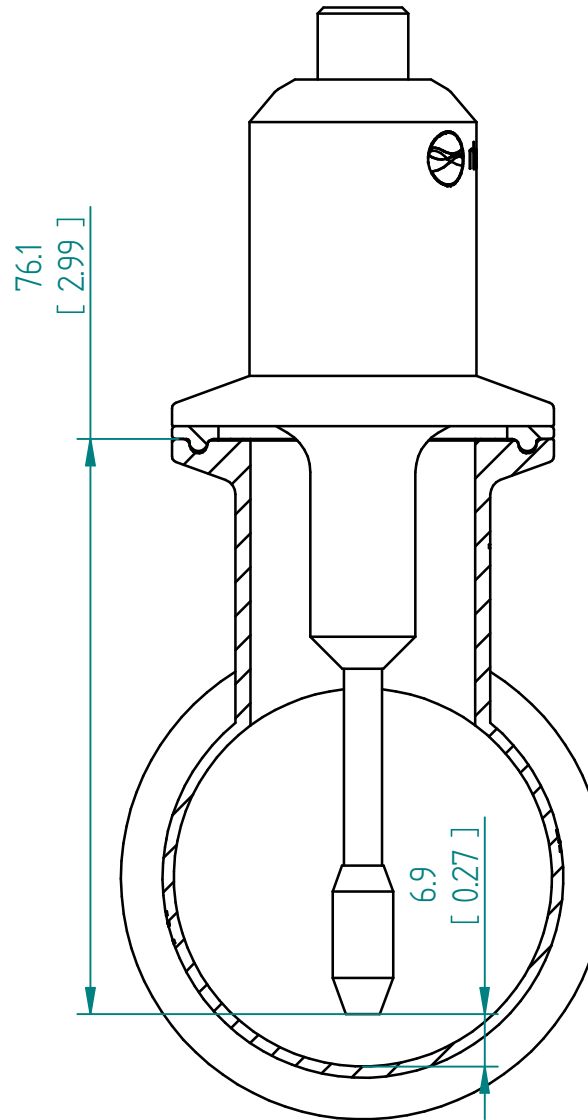

SRD-X3-15T

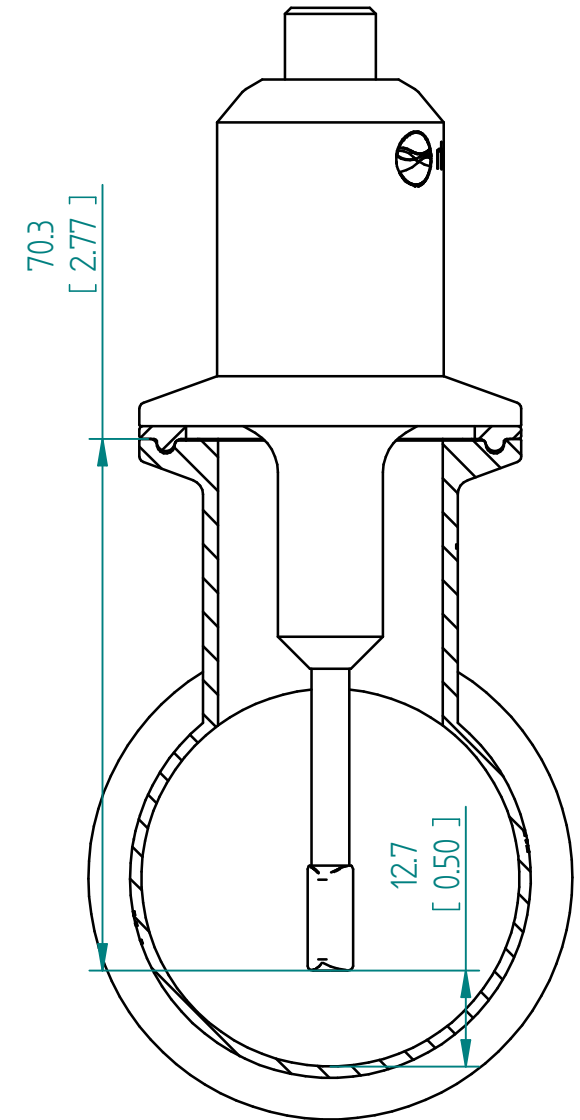

rheonics

inline process
density and viscosity
monitoring



This drawing remains property of rheonics. It may be neither copied nor informed to third persons or competitors without our approval. (2 paragraph 1 fig.7 copyright act of 9th Sept. 1965)

Installation Drawing FTP-15T-20T

Protected by US and International patents granted and pending

rheonics • Switzerland • USA • www.rheonics.com • info@rheonics.com +41 52 511 32 00 +1 713 364 5427

Release: 2502